

MODELING & DESIGNING OF AN ADVANCED GRID CONNECTED HYBRID BRIDGE BASED MULTI (FIVE) LEVEL STATCOM

Lam Aneesh¹, R.H.Naik², P.Purna Chandrarao³

¹M.Tech (PSC & AE) Student Department Of EEE, Chalapathi Institute Of Technology.

² Asst. Professor, Department Of EEE, Chalapathi Institute Of Technology, Mothadaka.

³ Head Of The Department Of EEE, Chalapathi Institute Of Technology, Mothadaka.

ABSTRACT:

In electric power system, the harmfulness to system because of lack of reactive power cannot be ignored. STATCOM (Static Synchronous Compensator) is an important member of Flexible AC Transmission System, comparing with traditional reactive power compensation device, it not only decrease the volume and cost of the device, but also has faster response speed and more smooth regulating property. On the basis of thorough analysis on reactive power compensation device in existence, this paper study on two, three & five-level STATCOM. The device uses neutral-point clamping method to divide the inverter circuit into positive, negative and zero three level, so that each component subject to the maximum voltage reduced to half of the traditional inverter circuit.

INTRODUCTION:

Distribution systems are facing severe power-quality (PQ) problems, such as poor voltage regulation, high reactive power and harmonics current burden, load unbalancing, excessive neutral current, etc. The remedial solutions to the PQ problems are investigated and discussed in the literature and the group of devices is known as custom power devices (CPDs). The distribution static compensator (STATCOM) is proposed for compensating PQ problems in the current, and the dynamic voltage restorer (DVR) is used for mitigating the PQ problems in the voltage while the unified power-quality conditioner (UPQC) is proposed for solving current and voltage PQ problems. There are many techniques reported for the elimination of

harmonics from the source current as well as the compensation of the neutral current and load balancing. Some neutral current compensation techniques have been patented. Three-phase four wire distribution systems have been used to supply single-phase low-voltage loads. The typical loads may be computer loads, office automation machines, lighting ballasts, adjustable speeds drives (ASDs) in small air conditioners, fans, refrigerators, and other domestic and commercial appliances, etc., and generally behave as nonlinear loads. These loads may create problems of high input current harmonics and excessive neutral current. The neutral current consists of mainly triplen harmonics currents. The zero-sequence neutral current obtains a path through the neutral conductor. Moreover,

the unbalanced single-phase loads also result in serious zero-sequence fundamental current. The total neutral current is the sum of the zero sequence harmonic components and the zero-sequence fundamental component of the unbalanced load current, and this may overload the neutral conductor of the three-phase four-wire distribution system. A number of surveys have been cited about the causes of excessive neutral current in the distribution system. There are different techniques for the mitigation of neutral current in the three-phase four-wire distribution systems.

BASIC PRINCIPLE OF STATCOM:

A STATCOM is a controlled reactive source, which includes a Voltage Source Converter (VSC) and a DC link capacitor connected in shunt, capable of generating and/or absorbing reactive power. The operating principles of a STATCOM are based on the exact equivalence of the conventional rotating synchronous compensator. The AC terminals of the VSC are connected to the Point of Common Coupling (PCC) through an inductance, which could be a filter inductance or the leakage inductance of the coupling transformer, as shown

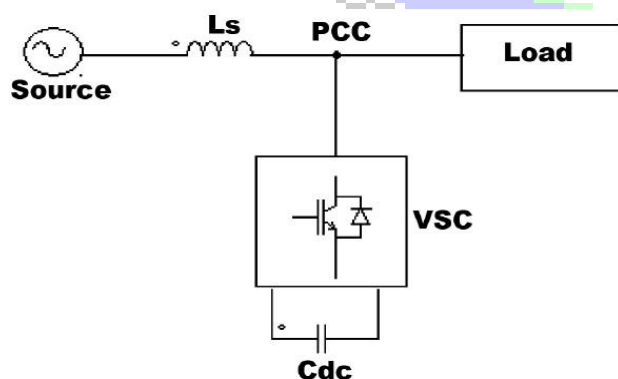


Fig.1 line diagram of STATCOM

The DC side of the converter is connected to a DC capacitor, which carries the input ripple current of the converter and is the main reactive energy storage element. This capacitor could be charged by a battery source, or could be pre-charged by the converter itself. If the output voltage of the VSC is equal to the AC terminal voltage, no reactive power is delivered to the system. If the output voltage is greater than the AC terminal voltage, the STATCOM is in the capacitive mode of operation and vice versa. The quantity of reactive power flow is proportional to the difference in the two voltages.

It is to be noted that voltage regulation at PCC and power factor correction cannot be achieved simultaneously. For a STATCOM used for voltage regulation at the PCC, the compensation should be such that the supply currents should lead the supply voltages; whereas, for power factor correction, the supply current should be in phase with the supply voltages. The control strategies studied in this paper are applied with a view to studying the performance of a STATCOM for power factor correction and harmonic mitigation.

MULTILEVEL CONVERTER:

An inverter is an electrical device that converts direct current (DC) to alternating current (AC); the converted AC can be at any required voltage and frequency with the use of appropriate transformers, switching, and control circuits.

Static inverters have no moving parts and are used in a wide range of applications, from small switching power supplies in computers, to large electric utility high-

voltage direct current applications that transport bulk power. Inverters are commonly used to supply AC power from DC sources such as solar panels or batteries.

A single-phase structure of an m-level cascaded inverter is illustrated in Figure 31.1. Each separate dc source (SDCS) is connected to a single-phase full-bridge, or H-bridge, inverter. Each inverter level can generate three different voltage outputs, $+V_{dc}$, 0, and $-V_{dc}$ by connecting the dc source to the ac output by different combinations of the four switches, S_1 , S_2 , S_3 , and S_4 . To obtain $+V_{dc}$, switches S_1 and S_4 are turned on, whereas $-V_{dc}$ can be obtained by turning on switches S_2 and S_3 . By turning on S_1 and S_2 or S_3 and S_4 , the output voltage is 0. The ac outputs of each of the different full-bridge inverter levels are connected in series such that the synthesized voltage waveform is the sum of the inverter outputs.

$$v_{an} = v_{a1} + v_{a2} + v_{a3} + v_{a4} + v_{a5}$$

For a stepped waveform such as the one depicted in Figure 31.2 with s steps, the Fourier Transform for this waveform follows

$$V(\omega) = \frac{4V_{dc}}{\pi} \sum_n \left[\cos(n\theta_1) + \cos(n\theta_2) + \dots + \cos(n\theta_s) \right] \frac{\sin(n\omega t)}{n}, \text{ where } n = 1, 3, 5, 7, \dots$$

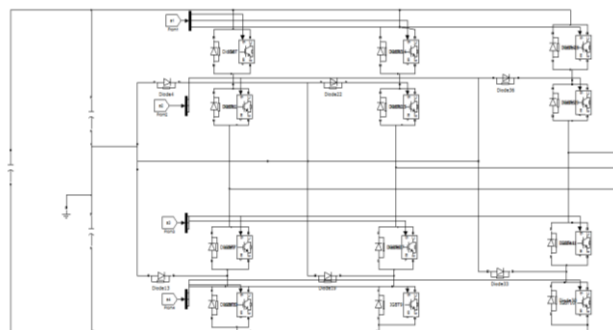


Fig.2 three level STATCOM

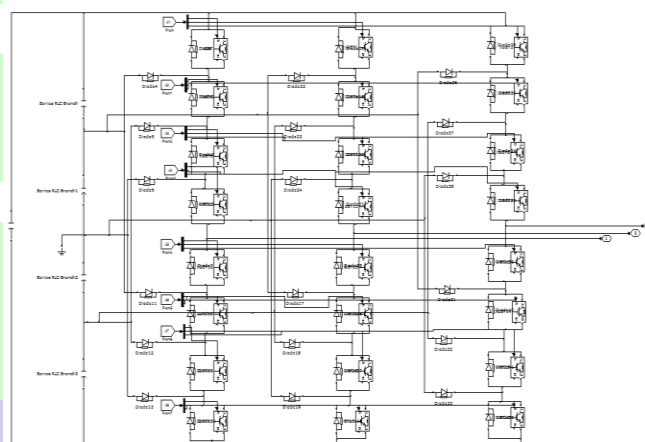


Fig.3 five level STATCOM

The magnitudes of the Fourier coefficients when normalized with respect to V_{dc} are as follows:

$$H(n) = \frac{4}{\pi n} \left[\cos(n\theta_1) + \cos(n\theta_2) + \dots + \cos(n\theta_s) \right], \text{ where } n = 1, 3, 5, 7, \dots$$

The conducting angles, $\theta_1, \theta_2, \dots, \theta_s$, can be chosen such that the voltage total harmonic distortion is a minimum. Generally, these angles are chosen so that predominant lower frequency harmonics, 5th, 7th, 11th, and 13th, harmonics are

eliminated. More detail on harmonic elimination techniques will be presented in the next section.

Multilevel cascaded inverters have been proposed for such applications as static vargeneration, an interface with renewable energy sources, and for battery-based applications. Three-phase cascaded inverters can be connected in wye, as shown in Figure, or in delta. Peng has demonstrated a prototype multilevel cascaded static var generator connected in parallel with the electrical system that could supply or draw reactive current from an electrical system.

CONTROL STRATEGIES

Satisfactory performance, fast response, flexible and easy implementation are the main objectives of any compensation strategy. The control strategies of a STATCOM are mainly implemented in the following steps:

- Measurements of system variables and signal conditioning
- Extraction of reference compensating signals
- Generation of firing angles for switching devices

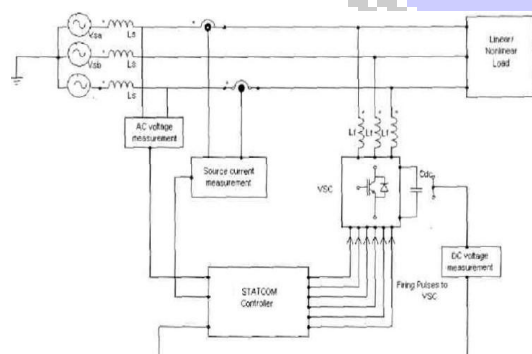


Figure.4 schematic diagram of STATCOM

Figure.3 shows the schematic diagram of STATCOM control taking into consideration the above steps. The generation of proper pulse width modulation (PWM) firing is the most important part of STATCOM control and it has a great impact on its compensation objectives, transient as well as steady state performance. Since a STATCOM shares many concepts with that of a STATCOM at the transmission level, a few control techniques have been directly implemented to a STATCOM, incorporating PWM switching, rather than fundamental frequency switching (FFS) methods. A PWM based distribution static compensator offers faster response and capability for harmonic elimination. This paper is an attempt to compare the following schemes of a STATCOM for power factor correction and harmonic mitigation based on:

1. Phase shift control
2. Indirect decoupled current control
3. Regulation of AC bus and DC link voltage

The performance of STATCOM with different control schemes have been studied through digital simulations for common system parameters, as given in the Appendix.

• Phase Shift Control

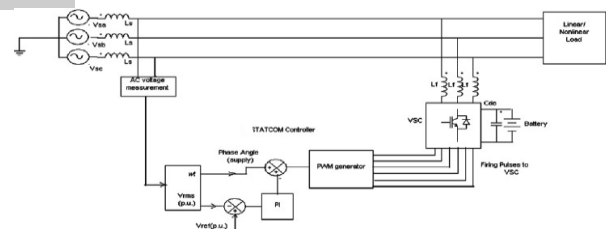


Figure.5 control diagram of STATCOM

The schematic diagram of phase shift control is shown in figure. In this method, the compensation is achieved by the measuring of the rms voltage at the load point, whereas no reactive power measurements are required. Sinusoidal PWM technique is used with constant switching frequency. The error signal obtained by comparing the measured system rms voltage and the reference voltage is fed to a proportional integral (PI) controller, which generates the angle for deciding the necessary phase shift between the output voltage of the VSC and the AC terminal voltage. This angle is summed with the phase angle of the balanced supply voltages, assumed to be equally spaced at 120 degrees, to produce the desired synchronizing signal required to operate the PWM generator. In this scheme, the DC voltage is maintained constant, using a separate battery source.

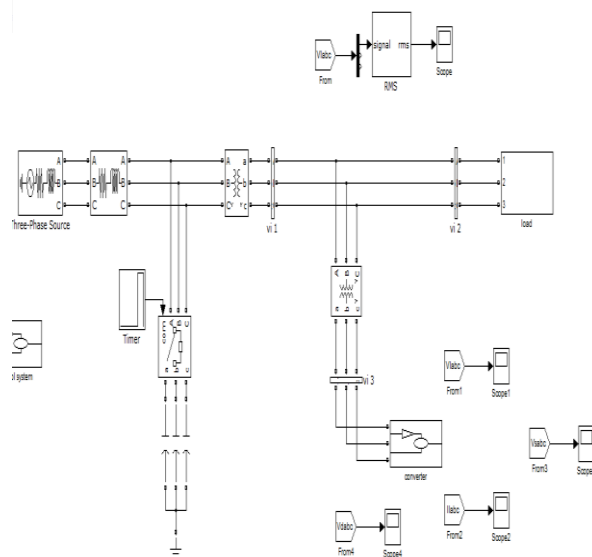


Fig.6 simulation model of three level STATCOM

Figure a and figure b show the simulation results obtained using phase shift control for reactive power compensation and harmonic mitigation for a balanced varying linear load and for a non linear load respectively. It is observed that the source current and the source voltage are in phase, correcting the power factor of the system in case of a linearly varying load; whereas, complete compensation is not achieved in case of nonlinear load (source current THD 24.34%). The frequency spectrum of the source current for a nonlinear load, before and after compensation, is shown in Figure a and Figure b. Though this strategy is easy to implement, is robust and can provide partial reactive power compensation without harmonic suppression, it has the following major disadvantages:

- The controller does not use a self supporting DC bus and thus requires a very large DC source to pre charge the capacitor.
- Balanced source supply as rms voltage is assumed and the supply phase angle are calculated over the fundamental only.
- No harmonic suppression and partial compensation is achieved in case of nonlinear loads.

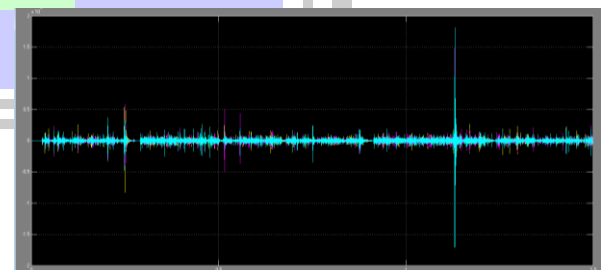


Fig.7 five level STATCOM source current

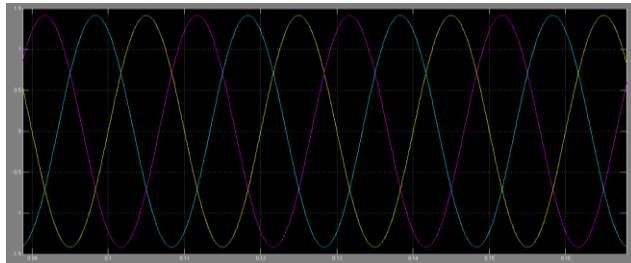


Fig: 8 five level STATCOM load current

• Indirect Decoupled Current Control

This scheme is based on the governing equations of advanced static var compensator. It requires the measurement of instantaneous values of three phase line voltages and current. Figure shows the block diagram representation of the control scheme. The control scheme is based on the transformation of the three phase system to a synchronously rotating frame, using Park's transformation.

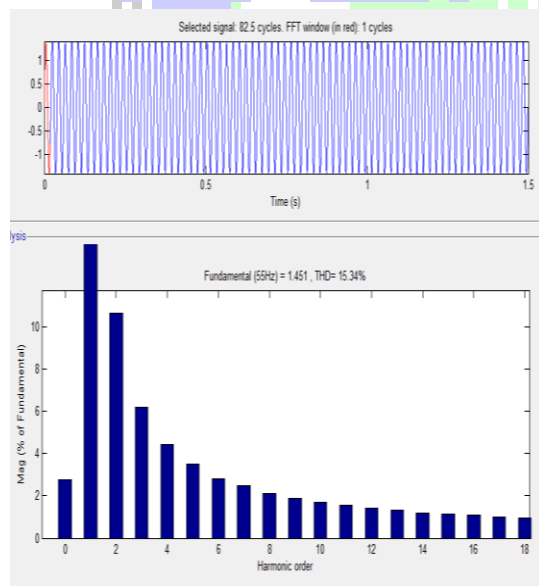


Fig. 10 THD of three level STATCOM

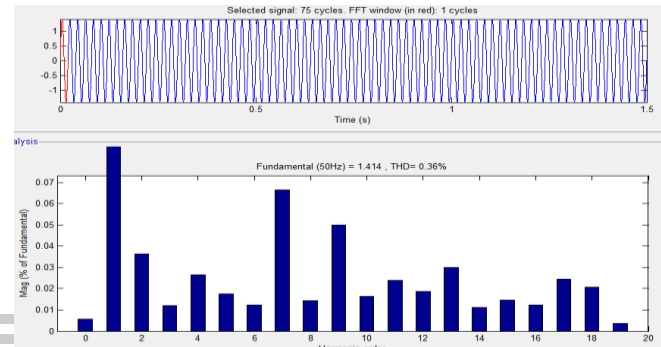


Fig. 10 THD of five level STATCOM

CONCLUSION:

The causes, standards, and mitigation techniques of the excessive neutral current have been investigated in the three-phase four-wire distribution system. The modeling and simulation of the T Connected transformer has been demonstrated for neutral current compensation. The T-connected transformer has mitigate the source neutral current. The total kilovolt amperes rating of the T-connected transformer is lower than a star/Delta transformer for a given neutral current Compensation.

REFERENCES:

- [1] G. T. Heydt, Electric Power Quality, 2nd ed. West Lafayette, IN: Stars in a Circle, 1994.
- [2] R. C. Dugan, M. F. McGranaghan, and H. W. Beaty, Electric Power Systems Quality. New York: McGraw Hill, 1996.
- [3] M. H. J. Bollen, Understanding Power Quality Problems: Voltage Sags and Interruptions, ser. IEEE Press Power Eng. Piscataway, NJ: IEEE, 2000.
- [4] J. Arrilaga, N. R. Wattson, and S. Chen, Power System Quality Assessment. New York: Wiley, 2000.
- [5] C. Sankaran, Power Quality. Boca Raton, FL: CRC, 2001.